Approved For Release : CIA-RDP62-00328A000200090001-5

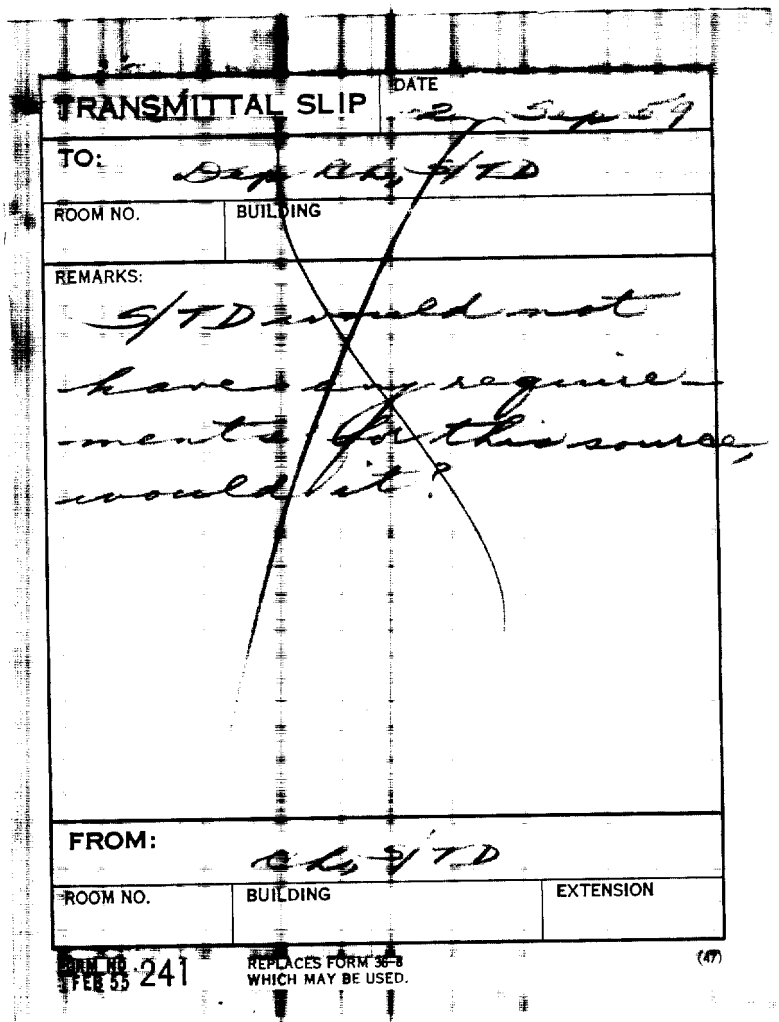

TRANSMITTAL SLIP

DATE 2 Sept 59

TO: Dep Adj S/TD

ROOM NO. | BUILDING

REMARKS:

S/TD should not have any requirements for this source, would it?

FROM: Adj S/TD

ROOM NO. | BUILDING | EXTENSION

FORM NO. 241 REPLACES FORM 36-8 WHICH MAY BE USED. (47)

FEB 55

Approved For Release : CIA-RDP62-00328A000200090001-5